

**Force Engineering & Testing**

19530 Ramblewood Drive  
Humble, Texas 77338  
Phone: (281) 540-6603 FAX: (281) 540-9966  
Website: [www.forceengineeringtesting.com](http://www.forceengineeringtesting.com)

**Product Evaluation Report**  
**SUNSHINE METAL SUPPLY, INC.**

***1 1/2" Mechanical Lock, 24 Ga. 16" Wide Roof Panel over Plywood***

**Florida Product Approval # 18386.2 R3**

Florida Building Code 2020

Per Rule 61G20-3

Method: 1 -D

Category: Roofing

Subcategory: Metal Roofing

Compliance Method: 61G20-3.005(1)(d)

HVHZ

**Product Manufacturer:**

**Sunshine Metal Supply, Inc.**

**719 Cattleman Road**

**Sarasota, Florida 34232**

**Engineer Evaluator:**

**Johnathan Green, P.E. #88223**

**Florida Evaluation ANE ID: 12901**


**Contents:**

**Evaluation Report: Page 1 - 4**

**Installation Detail: Page 5 - 14**



<b>Compliance Statement:</b>	The product as described in this report has demonstrated compliance with the Florida Building Code 2020, Sections 1504.3.2, 1518.9, 1523.6.5.2.4.
<b>Product Description:</b>	1-1/2" Mechanical Lock Standing Seam Roof Panel, 24 Ga. Steel, 16" Wide, Roof Panel restrained with steel slider clips into APA Plywood decking. Non-structural Application.
<b>Panel Material/Standards:</b>	Material: 24 Ga. Steel, ASTM A792 unpainted or painted with Valspar Fluropon or ASTM A653 G90 conforming to Florida Building Code 2020 Section 1507.4.3. Yield Strength: Min. 50.0 ksi Corrosion Resistance: Panel Material shall comply with Florida Building Code 2020, Section 1507.4.3.
<b>Panel Dimension(s):</b>	Thickness: 0.024" Width: 16" max coverage Rib Height: 1-1/2" Panel Seam: 180° Seam, Double Lock w/ mechanical seamer
<b>Roof Panel Clips:</b>	Product Name: 1500SC, 1-1/2" Sliding Clip Assembly Type: Two Piece Slider Top: 22 Ga. Galvanized Steel Base: 16 Ga. Galvanized Steel Corrosion Resistance: Per Florida Building Code 2020 Section 1506.7
<b>Roof Clip Fastener:</b>	(2) #12-11 x 1" Pancake Type A, ¼" minimum penetration through plywood Corrosion Resistance: Per Florida Building Code 2020, Section 1517.6.
<b>Substrate Description:</b>	1) For HVHZ construction, use 19/32" or greater APA Rated plywood or wood plank. In reroofing applications where the deck is less than 19/32" thick (min. 15/32") the attachment of the decking in no case shall be less than 8D annual ring shank nails at 6" O.C. Design of plywood and plywood supports are outside the scope of this evaluation. Substrate must be designed in accordance w/ Florida Building Code 2020.  2) For Non-HVHZ applications, use min. 15/32" thick, APA Rated plywood over supports at maximum 24" O.C. Design of plywood and plywood supports are outside the scope of this evaluation. Substrate must be designed in accordance w/ Florida Building Code 2020.

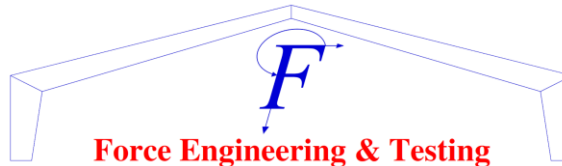

**Force Engineering & Testing**

19530 Ramblewood Drive  
 Humble, Texas 77338  
 Phone: (281) 540-6603 FAX: (281) 540-9966  
 Website: [www.forceengineeringtesting.com](http://www.forceengineeringtesting.com)

**Allowable Design Uplift Pressures:**

Table "A"

<b>Maximum Total Uplift Design Pressure:</b>	59.75 psf	73.9 psf	81.0 psf	88.1 psf	102.3 psf	123.5 psf
<b>Clip Spacing:</b>	24" O.C.	20" O.C.	18" O.C.	16" O.C.	12" O.C.	6" O.C.
<b># Fasteners per Clip:</b>	2	2	2	2	2	2

\*Design Pressure includes a Safety Factor = 2.0.

**Code Compliance:**

The product described herein has demonstrated compliance with The Florida Building Code 2020, Section 1504.3.2, 1518.9, 1523.6.5.2.4.

**Evaluation Report Scope:**

The product evaluation is limited to compliance with the structural wind load requirements of the Florida Building Code 2020, as relates to Rule 61G20-3.

**Performance Standards:**

The product described herein has demonstrated compliance with:

- TAS 125-03
- UL 580-06 - Test for Uplift Resistance of Roof Assemblies
- UL 1897-2012 - Uplift Test for Roof Covering Systems
- TAS 100-95 - Test Procedure for Wind and Wind Driven Rain Resistance of Discontinuous Roof Systems
- TAS 110-00 - Accel. Weathering ASTM G 155 / Salt Spray ASTM B 117


**Reference Data:**

1. TAS 125-03: UL 580-94 / 1897-98 Uplift Test  
 Force Engineering & Testing, Inc. (FBC Organization # TST-5328)  
 Report No. 72-0313T-06\*
2. TAS 100-95  
 Farabaugh Engineering & Testing, Inc. (FBC Organization # TST-1654)  
 Report No. T157-07\*
3. TAS 110-00: Valspar Fluropon coated metal panel testing  
 A) ASTM G 155  
 B) ASTM B 117
4. Certificate of Independence  
 By Johnathan Green, P.E. (No. 88223) @ Force Engineering & Testing  
 (FBC Organization # ANE ID: 12901)



- Test Standard Equivalency:**
1. The UL 580-94 test standard is equivalent to the UL 580-06 test standard.
  2. The UL 1897-98 test standard is equivalent to the UL 1897-2012 test standard.
- Quality Assurance Entity:**
- The manufacturer has established compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.
- Minimum Slope Range:**
- 2:12. Minimum Slope shall comply with Florida Building Code 2020, including Sections 1515.2.2 and in accordance with Manufacturers recommendations.
- Installation:**
- Install per manufacturer's recommended details and RAS 133.
- Underlayment:**
- Per Manufacturer's installation guidelines per Florida Building Code 2020 Section 1518.2, 1518.3, 1518.4.
- Fire Barrier:**
- Any approved fire barrier having a current NOA. Refer to a current fire directory listing for fire ratings of this roofing system assembly as well as the location of the fire barrier within the assembly. Fire classification is not part of this acceptance.
- Shear Diaphragm:**
- Shear diaphragm values are outside the scope of this report.
- Design Procedure:**
- Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the Florida Building Code 2020 for roof cladding wind loads. These component wind loads for roof cladding are compared to the allowable pressure listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with Florida Building Code 2020 Chapter 22 for steel, Chapter 23 for wood and Chapter 16 for structural loading.


\*The Test Reports are owned by Metalforming, Inc. Metalforming, Inc. gives the above manufacturer permission to use these test reports.

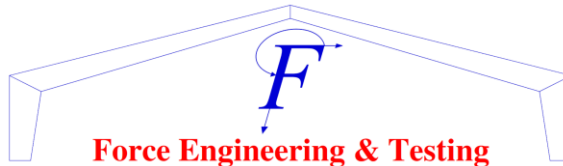


**Force Engineering & Testing**

19530 Ramblewood Drive  
Humble, Texas 77338  
Phone: (281) 540-6603 FAX: (281) 540-9966  
Website: [www.forceengineeringtesting.com](http://www.forceengineeringtesting.com)

**ML 150H 24 GA. STEEL PANEL**

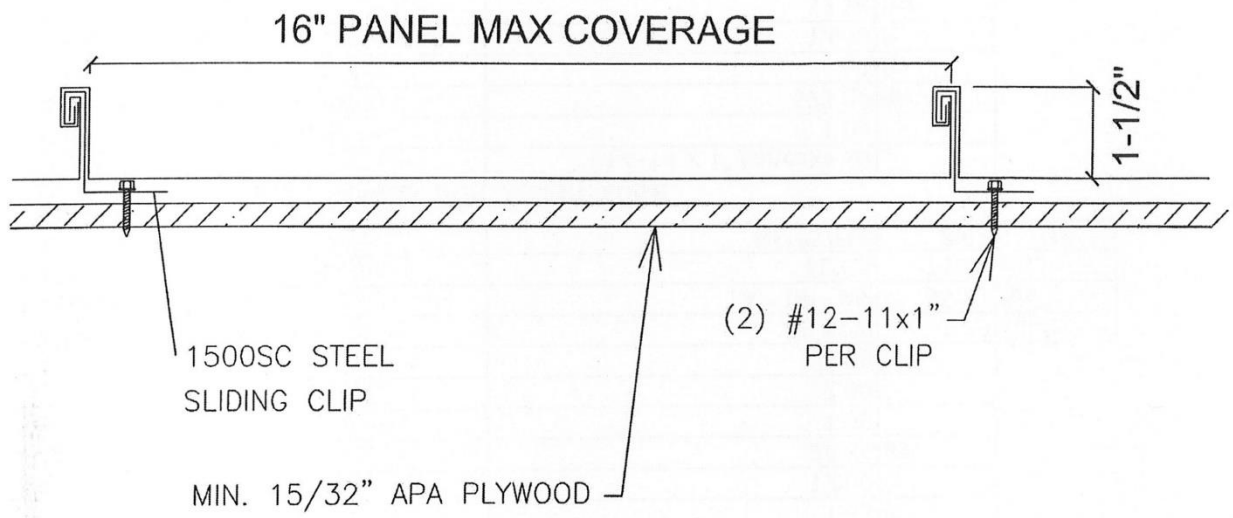


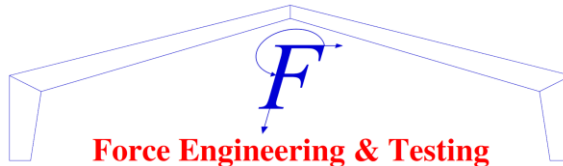


**Force Engineering & Testing**

19530 Ramblewood Drive  
Humble, Texas 77338


Phone: (281) 540-6603 FAX: (281) 540-9966  
Website: [www.forceengineeringtesting.com](http://www.forceengineeringtesting.com)

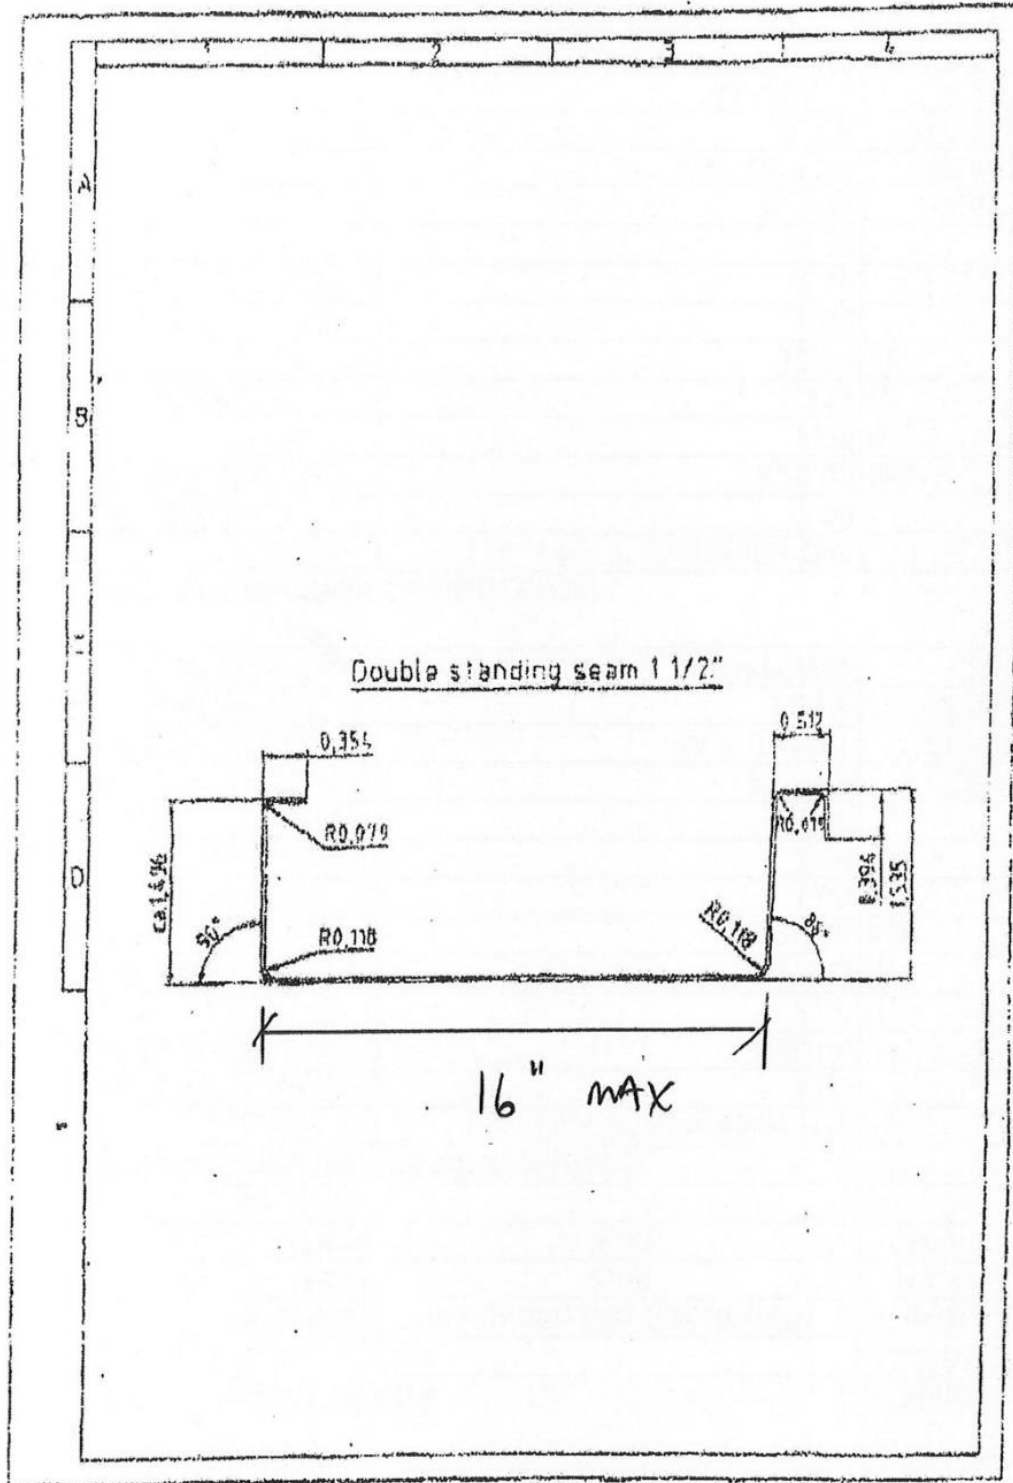


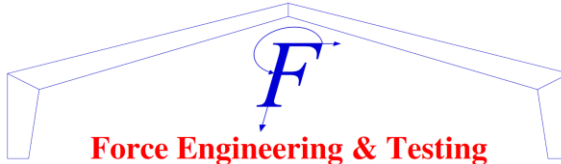

**Force Engineering & Testing**

19530 Ramblewood Drive  
 Humble, Texas 77338  
 Phone: (281) 540-6603 FAX: (281) 540-9966  
 Website: www.forceengineeringtesting.com

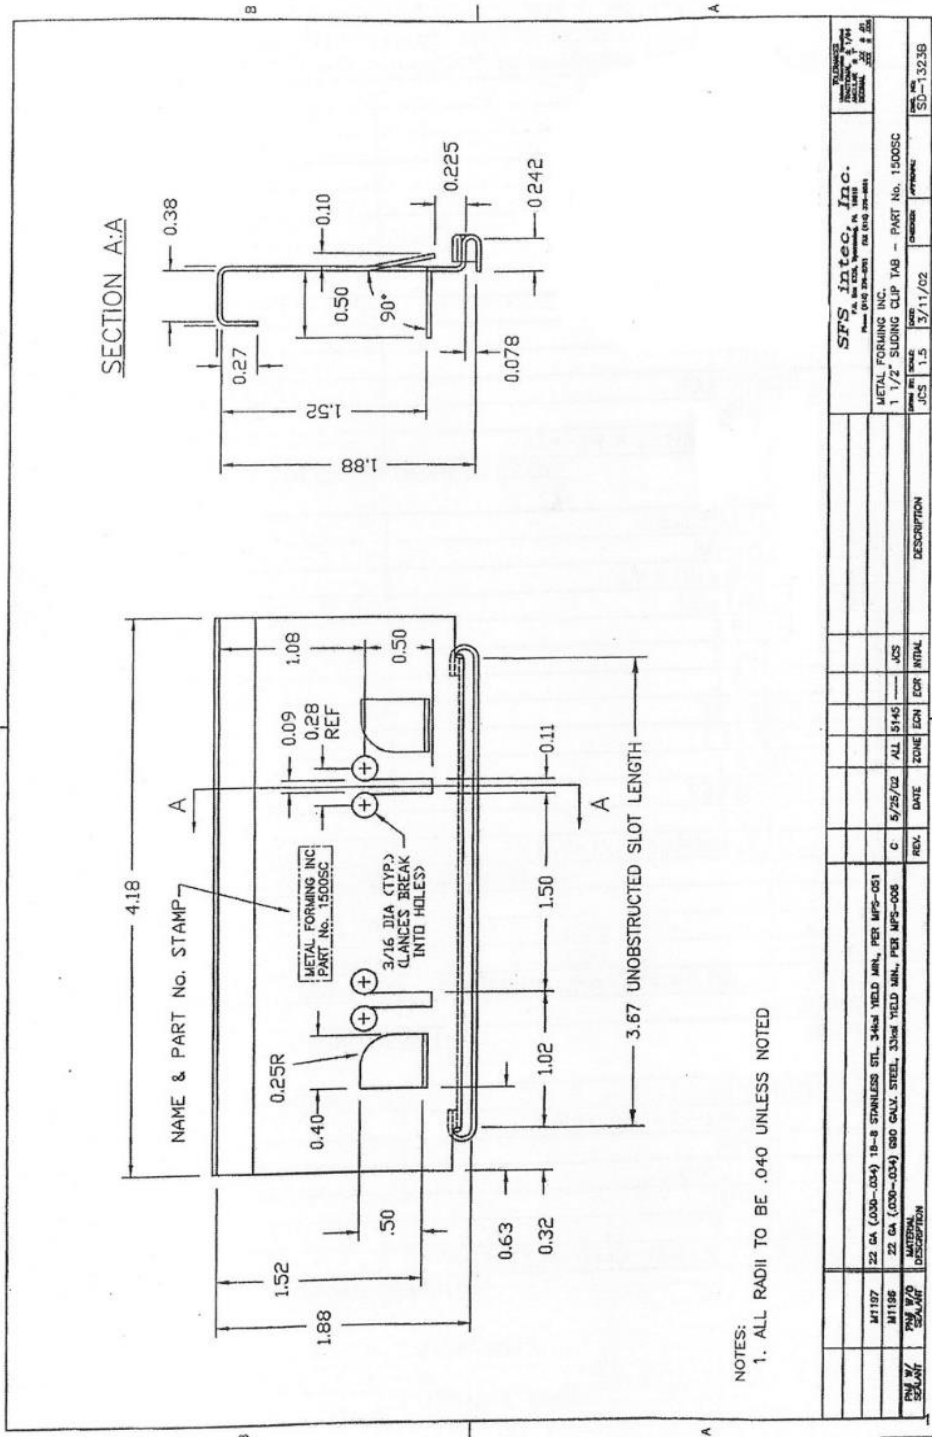


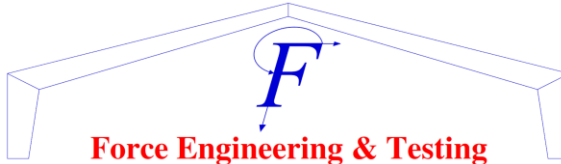

# Force Engineering & Testing

19530 Ramblewood Drive  
Humble, Texas 77338

Phone: (281) 540-6603 FAX: (281) 540-9966  
Website: www.forceengineeringtesting.com

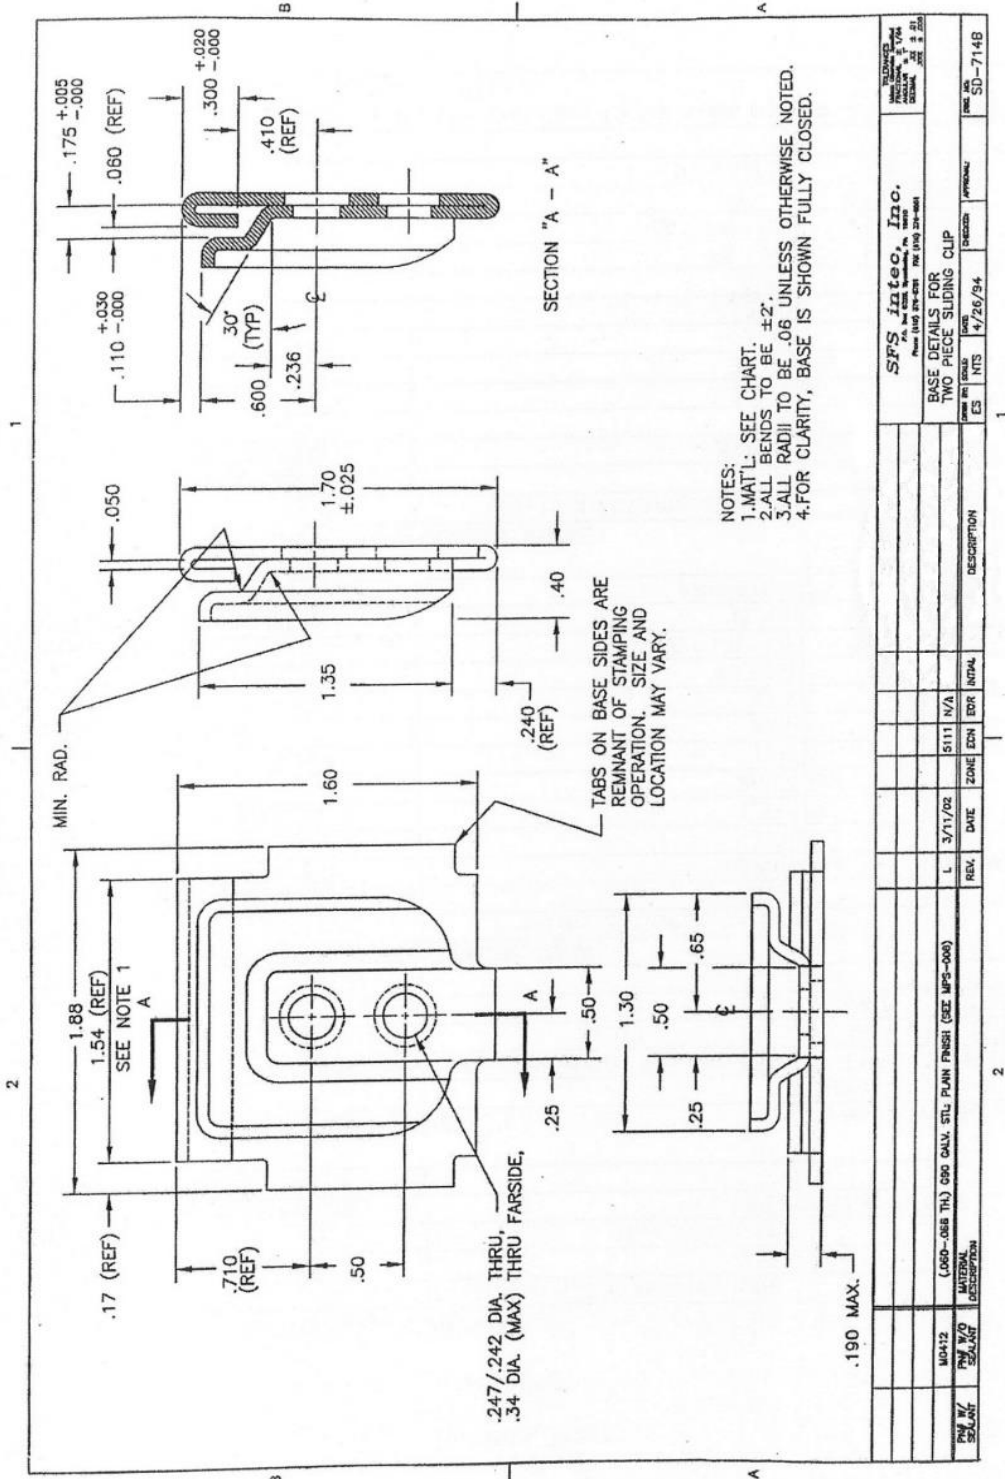

REV.	DATE	ZONE	EDN	EDR	INTPL	DESCRIPTION
L	3/11/02				5111	N/A

REV.	DATE	ZONE	EDN	EDR	INTPL	DESCRIPTION
ES	4/26/94					


  

MATERIAL		MATERIAL		MATERIAL	
PMW N/O	SOULANT	PMW N/O	SOULANT	PMW N/O	SOULANT
M0412		M0412		M0412	
(060-.066 TH) 690 GALV. STL. PLAIN FINISH (SEE MFS-000)		(060-.066 TH) 690 GALV. STL. PLAIN FINISH (SEE MFS-000)		(060-.066 TH) 690 GALV. STL. PLAIN FINISH (SEE MFS-000)	

SFPS <i>in</i> tco, <i>It</i> co.		SFPS <i>in</i> tco, <i>It</i> co.		SFPS <i>in</i> tco, <i>It</i> co.	
BASE DETAILS FOR TWO PIECE SLIDING CLIP		BASE DETAILS FOR TWO PIECE SLIDING CLIP		BASE DETAILS FOR TWO PIECE SLIDING CLIP	
DATE	4/26/94	DATE	4/26/94	DATE	4/26/94
DESIGN	ES	DESIGN	ES	DESIGN	ES
APPROVAL		APPROVAL		APPROVAL	
REV. NO.	50-7148	REV. NO.	50-7148	REV. NO.	50-7148




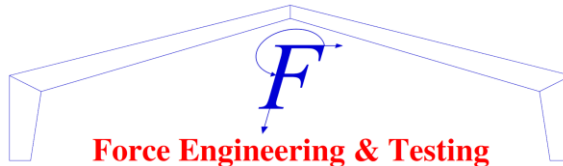


## Force Engineering & Testing

19530 Ramblewood Drive  
Humble, Texas 77338

Phone: (281) 540-6603 FAX: (281) 540-9966  
Website: [www.forceengineeringtesting.com](http://www.forceengineeringtesting.com)

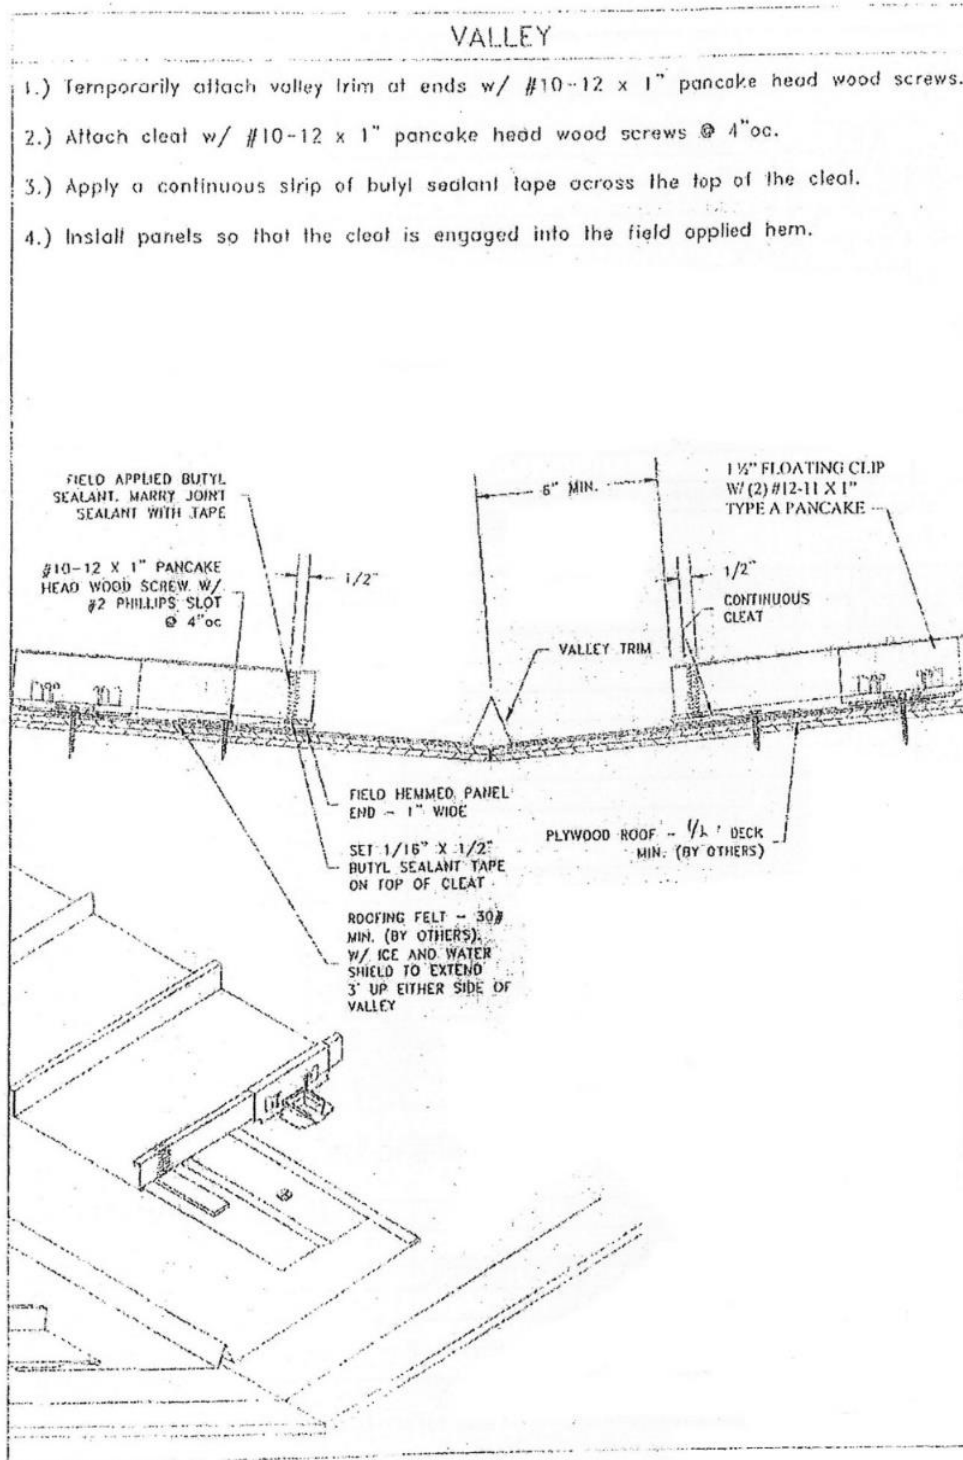

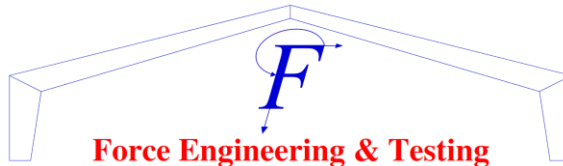



## Force Engineering & Testing

19530 Ramblewood Drive  
Humble, Texas 77338  
Phone: (281) 540-6603 FAX: (281) 540-9966  
Website: [www.forceengineeringtesting.com](http://www.forceengineeringtesting.com)

### LOW EAVE / GUTTER

- 1.) Temporarily attach gutter at ends w/ #10-12 x 1" pancake head wood screws.
- 2.) Attach cleat through gutter w/ #10-12 x 1" pancake head wood screws @ 4"oc.
- 3.) Apply a row of butyl sealant tape across the top of the cleat.
- 4.) Apply a row of butyl sealant tape across the top of the cleat.
- 5.) Install panels so that the cleat is engaged into the field applied hem.

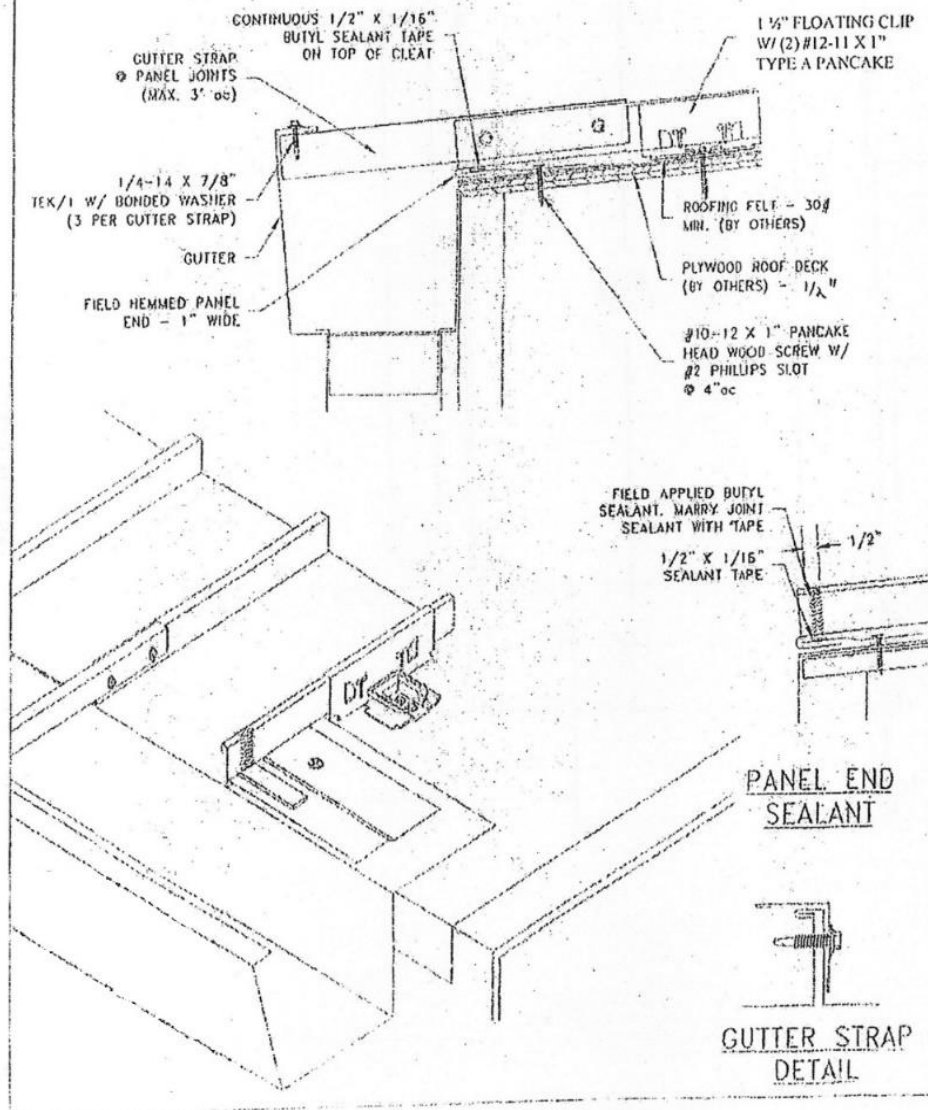

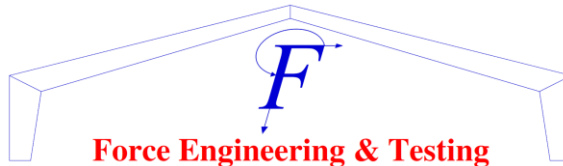

## Force Engineering & Testing

19530 Ramblewood Drive  
Humble, Texas 77338  
Phone: (281) 540-6603 FAX: (281) 540-9966  
Website: [www.forceengineeringtesting.com](http://www.forceengineeringtesting.com)

### FIELD HEMMED PANEL END

CUT FEMALE END  
BACK 1"

1. PANELS REQUIRING FIELD HEMMED ENDS SHOULD BE FABRICATED 1" LONGER THAN THE FINISHED PANEL LENGTH. VALLEY CONDITIONS MUST BE FIELD CUT TO THE APPROPRIATE ANGLE


2. CUT BACK PANEL JOINTS 1"


CUT MALE END  
BACK 1"

3. PLACE PROTRUDING PAN INTO THE PANEL HEMMING TOOL. THE FRONT EDGE OF THE TOOL MUST REST AGAINST THE NOTCHED JOINT LEGS ON BOTH SIDES.
4. WHILE MAINTAINING PRESSURE AGAINST THE PANEL JOINTS, ROTATE THE HEMMING TOOL AS CLOSE TO 180° AS POSSIBLE.

PANEL HEMMING TOOL

5. INSPECT COMPLETED HEM TO INSURE THAT THE HEM IS OPENED AND CAPABLE OF RECEIVING THE CLEAT (SEE ERECTION DETAILS).



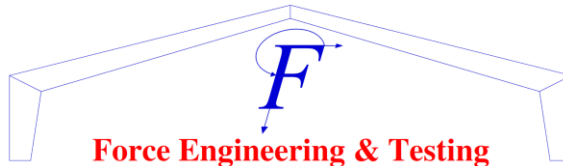



## Force Engineering & Testing

19530 Ramblewood Drive  
Humble, Texas 77338  
Phone: (281) 540-6603 FAX: (281) 540-9966  
Website: [www.forceengineeringtesting.com](http://www.forceengineeringtesting.com)

### LOW EAVE

- 1.) Temporarily attach eave trim at ends w/ #10-12 x 1" pancake head wood screws.
- 2.) Attach cleat through eave trim w/ #10-12 x 1" pancake head wood screws @ 4"oc.
- 4.) Apply a row of butyl sealant tape across the top of the cleat.
- 5.) Install panels so that the cleat is engaged into the field applied hem.

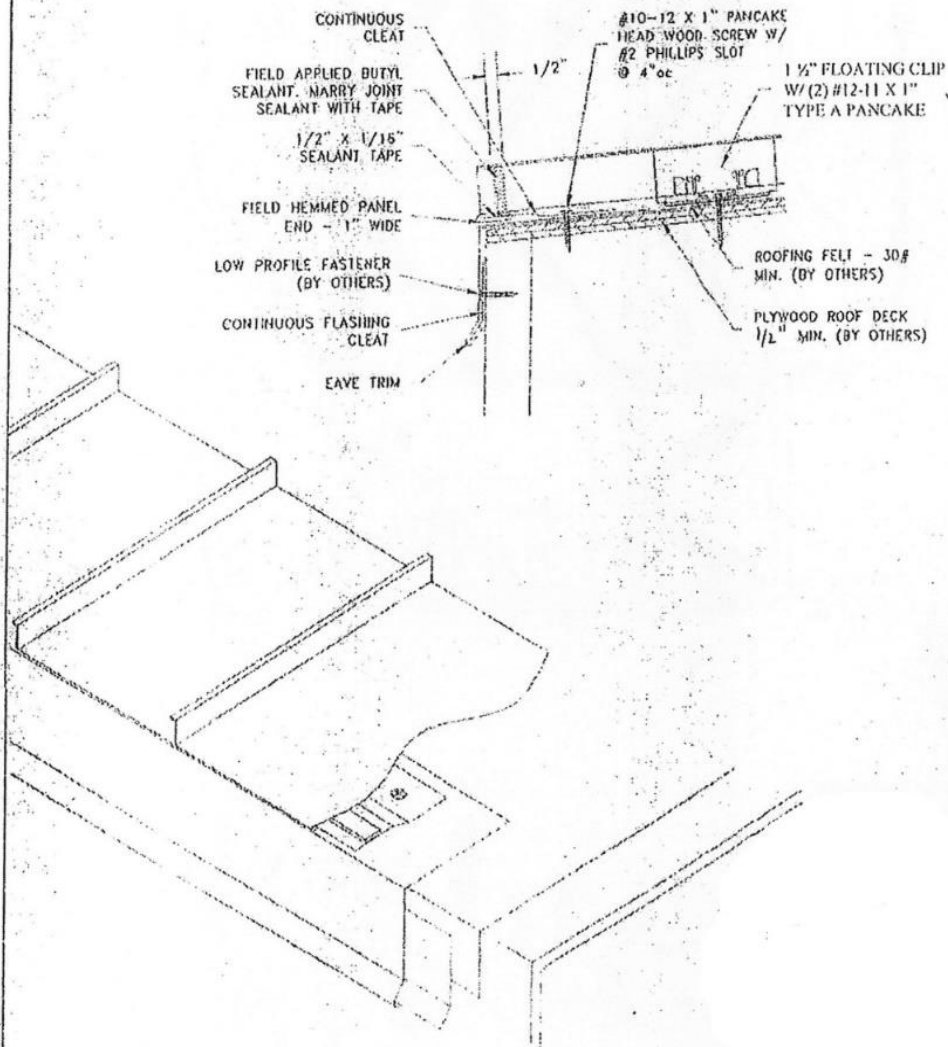

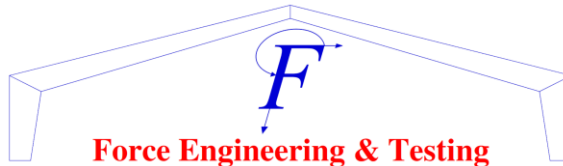



## Force Engineering & Testing

19530 Ramblewood Drive  
 Humble, Texas 77338  
 Phone: (281) 540-6603 FAX: (281) 540-9966  
 Website: [www.forceengineeringtesting.com](http://www.forceengineeringtesting.com)

### HIGH PROFILE RAKE

- 1.) Secure rake support angle through slots w/ #10-12 x 1" pancake head wood screw @ 4"oc.
- 2.) Turn panel edge up 1 1/2".
- 3.) Apply a continuous strip of sealant tape to the inside leg of the upturned edge
- 4.) Set ledge trim on sealant tape, and secure with 1/4-14 x 7/8" HWH Tek/1 @ 12"oc.
- 5.) Apply a continuous strip of sealant tape to the top of the ledge trim.
- 6.) Install the rake trim. Secure to ledge trim with 1/4-14 x 7/8" HWH Tek/1 fasteners at 12"oc.

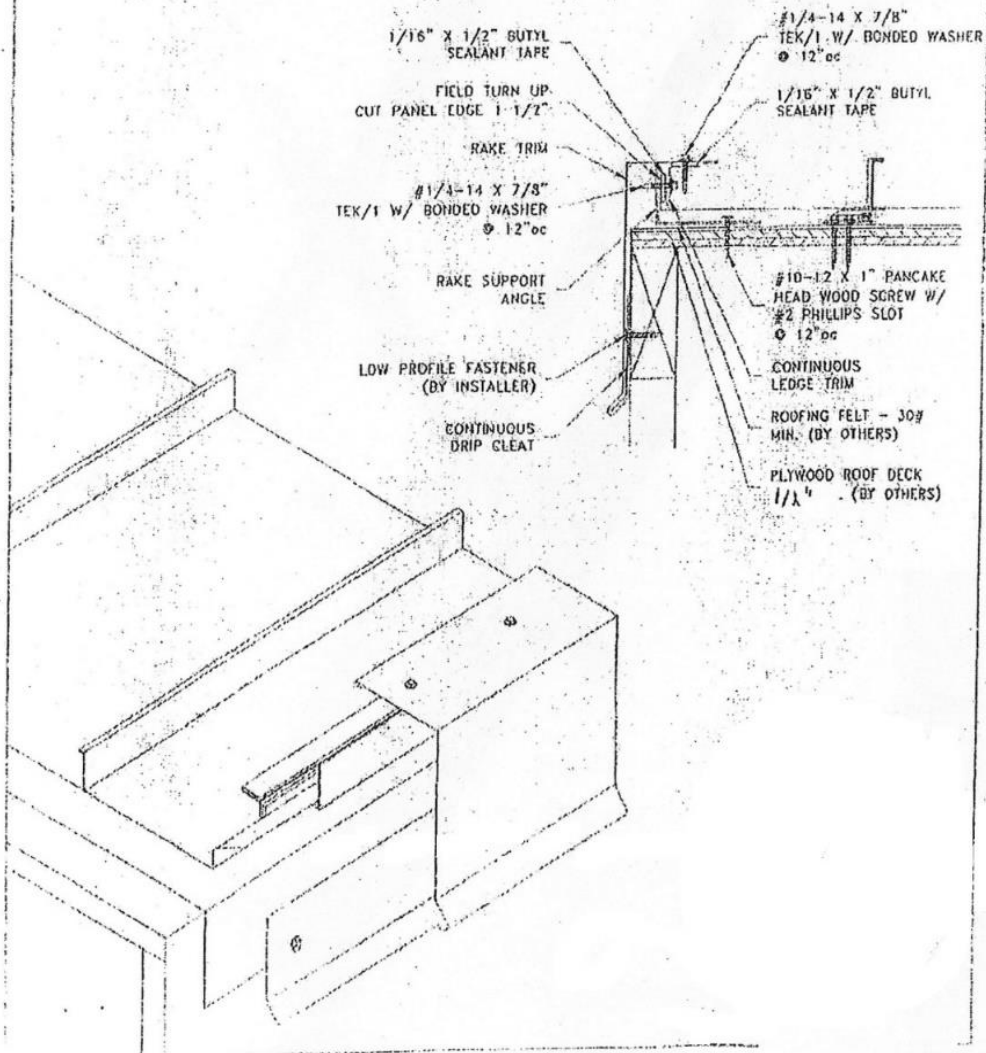

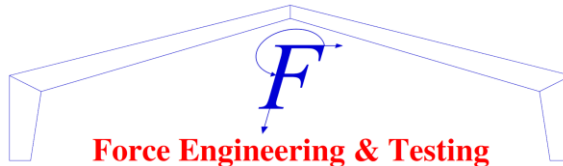

**Force Engineering & Testing**

19530 Ramblewood Drive  
 Humble, Texas 77338  
 Phone: (281) 540-6603 FAX: (281) 540-9966  
 Website: [www.forceengineeringtesting.com](http://www.forceengineeringtesting.com)

**HIGH EAVE**

- 1.) Determine location of zee closure. Apply sealant tape to flat of panel.
- 2.) Place closure on top of sealant tape. Clamp back-up angle to bottom of panel. Secure through tape and panel with #12-14 x 1" HWH Tek/3 fastener @ 4"oc. Seal the tab of the closure to the side joints with butyl sealant.
- 3.) Apply a continuous strip of sealant tape to the top of the zee closure. Seal between ends of tape with butyl sealant.
- 4.) Install the high eave trim. Secure to closure zee with 1/4-14 x 7/8" HWH Tek/1 fasteners at 12"oc.

