

**Force Engineering & Testing**

19530 Ramblewood Drive  
Humble, Texas 77338  
Phone: (281) 540-6603 FAX: (281) 540-9966  
Website: [www.forceengineeringtesting.com](http://www.forceengineeringtesting.com)

**Product Evaluation Report**  
**SUNSHINE METAL SUPPLY, INC.**

**5V Crimp 26 Ga. Roof Panel w/ #10 Fastener over 15/32" Plywood**

**Florida Product Approval # 40317.4 R2**


Florida Building Code 2023  
Per Rule 61G20-3  
Method: 1 -D

Category: Roofing  
Subcategory: Metal Roofing  
Compliance Method: 61G20-3.005(1)(d)  
NON HVHZ


Product Manufacturer:  
**Sunshine Metal Supply, Inc.**  
**719 Cattleman Road**  
**Sarasota, Florida 34232**

Engineer Evaluator:  
**Johnathan Green, P.E. #88223**  
**Florida Evaluation ANE ID: 12901**

Contents:  
**Evaluation Report: Pages 1 - 3**  
**Details: Page 4**

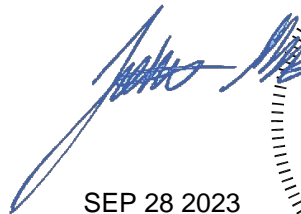


SEP 28 2023

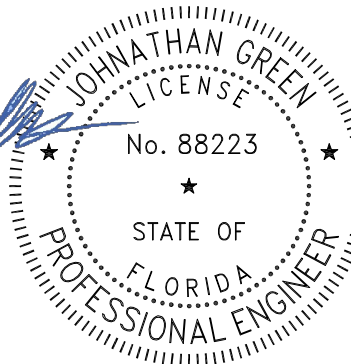

THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND SEALED BY JOHNATHAN GREEN ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

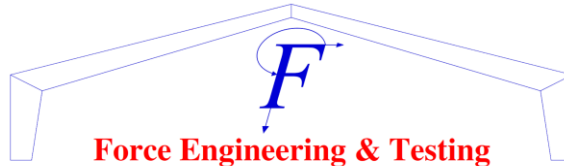

**Force Engineering & Testing**

19530 Ramblewood Drive  
Humble, Texas 77338

Phone: (281) 540-6603 FAX: (281) 540-9966  
Website: [www.forceengineeringtesting.com](http://www.forceengineeringtesting.com)

- Compliance Statement:** The product as described in this report has demonstrated compliance with the Florida Building Code 2023, Sections 1504.3.2.
- Product Description:** 5V Crimp Roof Panel, 26 Ga. Steel, 24" Coverage, Roof Panel with #10 fastener attaching to minimum 15/32" APA Plywood decking. Non-structural Application.
- Panel Material/Standards:** Material: 26 Ga. Steel conforming to Florida Building Code 2023 Section 1507.4.3  
Yield Strength: Min. 50.0 ksi  
Corrosion Resistance: Panel Material shall comply with Florida Building Code 2023, Section 1507.4.3
- Panel Dimension(s):** Thickness: 0.018" min.  
Width: 24" Maximum Coverage  
Rib Height: 1/2" tall ribs  
Panel Rollformer: Metal Rollforming Systems
- Panel Fastener:** (1) #10 x 1-1/2" Woodzip SCAMP SSC head HILO TP-17 with sealing washing or approved equal through panel rib.  
1/4" minimum penetration through plywood.  
Corrosion Resistance: Per Florida Building Code 2023, Section 1507.4.4.
- Substrate Description:** Minimum 15/32" thick, APA Rated plywood over supports at maximum 24" O.C. Solid 3/4" thick wood planking may be substituted for plywood if the wood planking has a fastener pull out value equal to or greater than 15/32" thick APA rated plywood. Design of plywood/wood planking and supports are outside the scope of this evaluation. Substrate must be designed in accordance w/ Florida Building Code.

**Allowable Design Uplift Pressures:**


**Panel Assembly over Min. 15/32" Plywood**

<b>Maximum Total Uplift Design Pressure:</b>	63.5 psf	103.5 psf	123.5 psf	153.5 psf
<b>Fastener Pattern:</b>	Panel Rib	Panel Rib	Panel Rib	Panel Rib
<b>Fastener Spacing:</b>	24" O.C.	16" O.C.	12" O.C.	6" O.C.

\*All Design Pressures Above includes a Safety Factor = 2.0.



<b>Code Compliance:</b>	The product described herein has demonstrated compliance with The Florida Building Code 2023, Section 1504.3.2.
<b>Evaluation Report Scope:</b>	The product evaluation is limited to compliance with the structural wind load requirements of the Florida Building Code 2023, as relates to Rule 61G20-3.
<b>Performance Standards:</b>	The product described herein has demonstrated compliance with: <ul style="list-style-type: none"><li>▪ UL 580-06 - Test for Uplift Resistance of Roof Assemblies</li><li>▪ UL 1897-2015 - Uplift Test for Roof Covering Systems</li></ul>
<b>Reference Data:</b>	<ol style="list-style-type: none"><li>1. UL 580-06 / 1897-12 Uplift Test Force Engineering &amp; Testing (FBC Organization # TST-5328) Report No. 596-0080-22T</li><li>2. Certificate of Independence By Johnathan Green, P.E. (No. 88223) @ Force Engineering &amp; Testing (FBC Organization # ANE ID: 12901)</li></ol>
<b>Test Standard Equivalency:</b>	The UL 1897-12 test standard is equivalent to the UL 1897-2015 test standard.
<b>Quality Assurance Entity:</b>	The manufacturer has established compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.
<b>Minimum Slope Range:</b>	Minimum Slope shall comply with Florida Building Code 2023, including Section 1507.4.2 and in accordance with Manufacturers recommendations. For slopes less than 3:12, lap sealant must be used in the panel side laps.
<b>Installation:</b>	Install per manufacturer's recommended details.
<b>Underlayment:</b>	Per Florida Building Code 2023, Section 1507.1 and manufacturer's installation guidelines.
<b>Roof Panel Fire Classification:</b>	Fire classification is not part of this acceptance.
<b>Shear Diaphragm:</b>	Shear diaphragm values are outside the scope of this report.
<b>Design Procedure:</b>	Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the Florida Building Code 2023 for roof cladding wind loads. These component wind loads for roof cladding are compared to the allowable pressure listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with Florida Building Code 2023 Chapter 22 for steel, Chapter 23 for wood and Chapter 16 for structural loading.

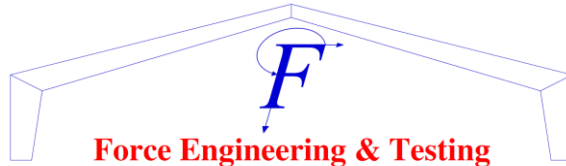


**Force Engineering & Testing**

19530 Ramblewood Drive  
Humble, Texas 77338

Phone: (281) 540-6603 FAX: (281) 540-9966  
Website: [www.forceengineeringtesting.com](http://www.forceengineeringtesting.com)

PANEL FASTENER PATTERN INTERIOR PANEL  
SEE EVALUATION REPORT FOR SPACINGS

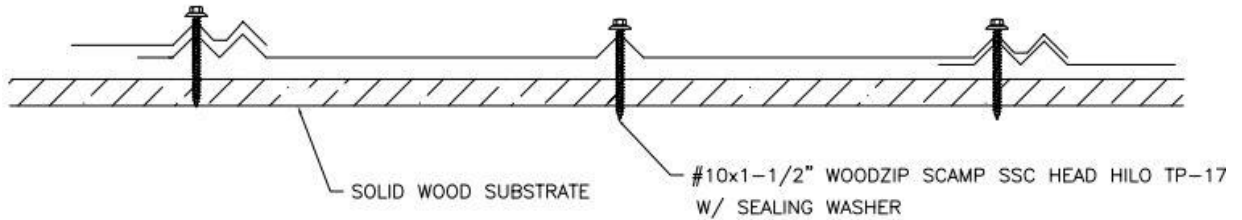

PANEL FASTENER PATTERN AT ENDS OF PANEL ONLY

